


Attachment to
April 3, 2010
LWV letter.

Received by the District
2 PM on 4/5/10



Water Supply Constraints Require Immediate Attention

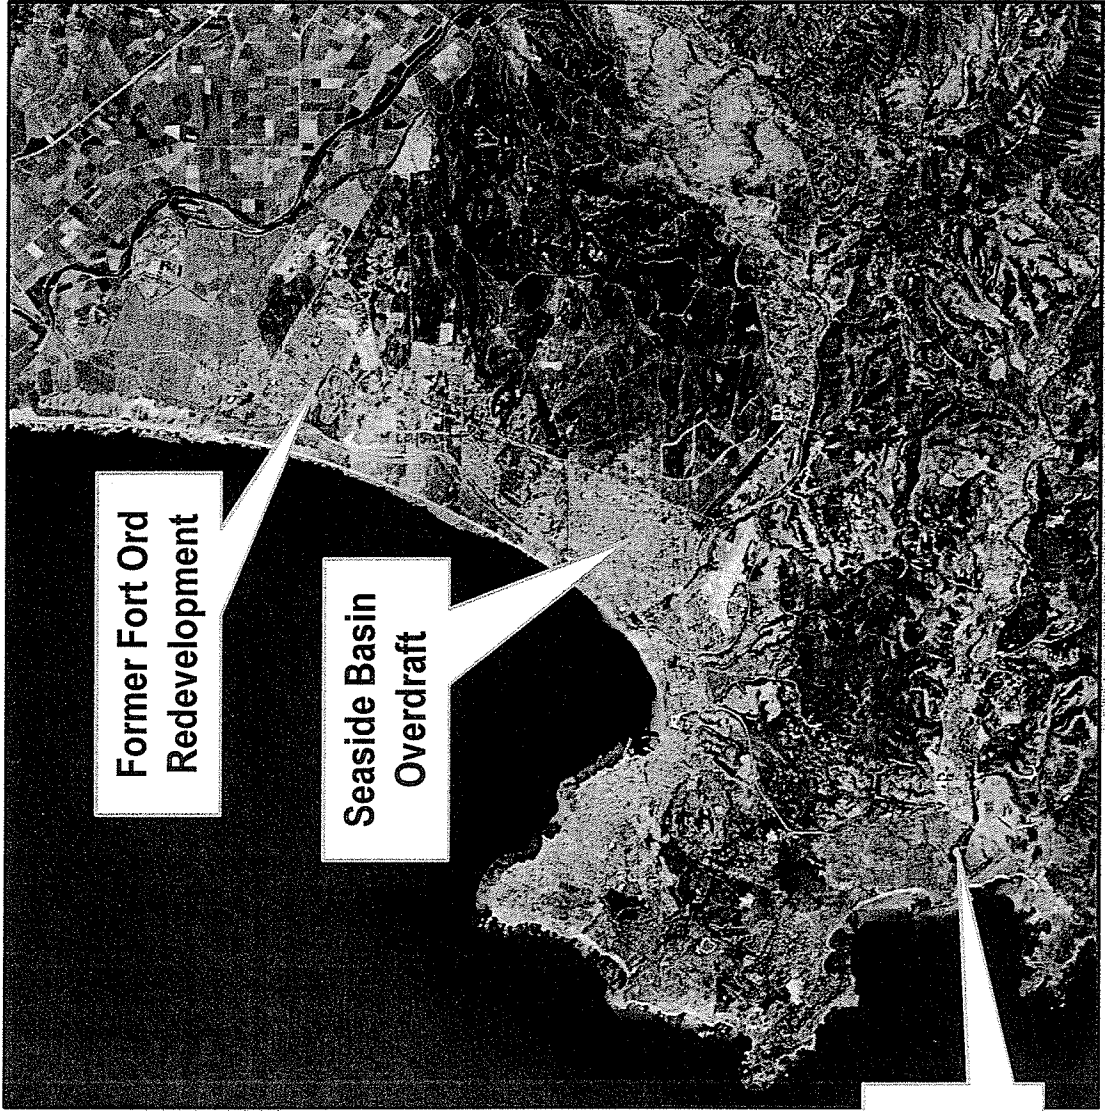


Former Fort Ord
Redevelopment

Seaside Basin
Overdraft


Carmel River
SWRCB Order
95-10 and CDO

Facilities will Rely on Power from Landfill Gas Cogeneration - Independent Project

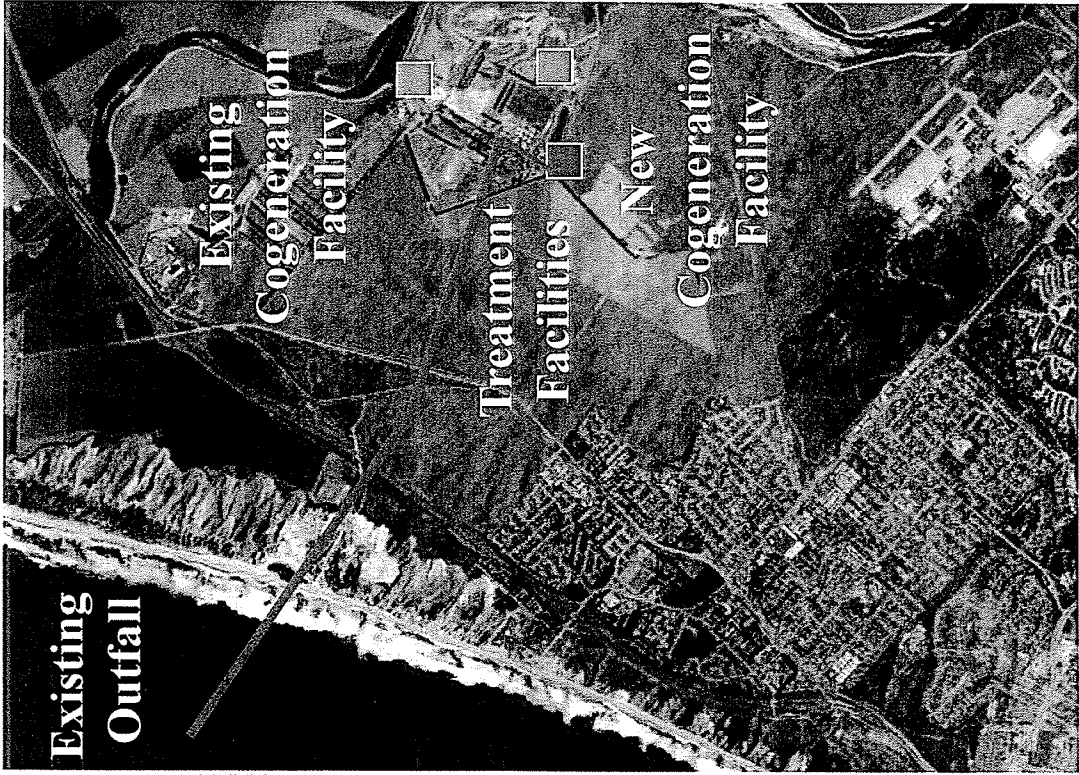

- Cogeneration power from adjacent landfill
 - New 6 mw cogeneration plant
 - Initially, energy source: combination of natural gas and methane
 - Tie to existing 5 mw cogeneration plant
- Renewable energy credits
- Long-term, low-cost reliable energy supply
- Addresses potential GHG impacts

Regional Project Provides Least Cost Solution

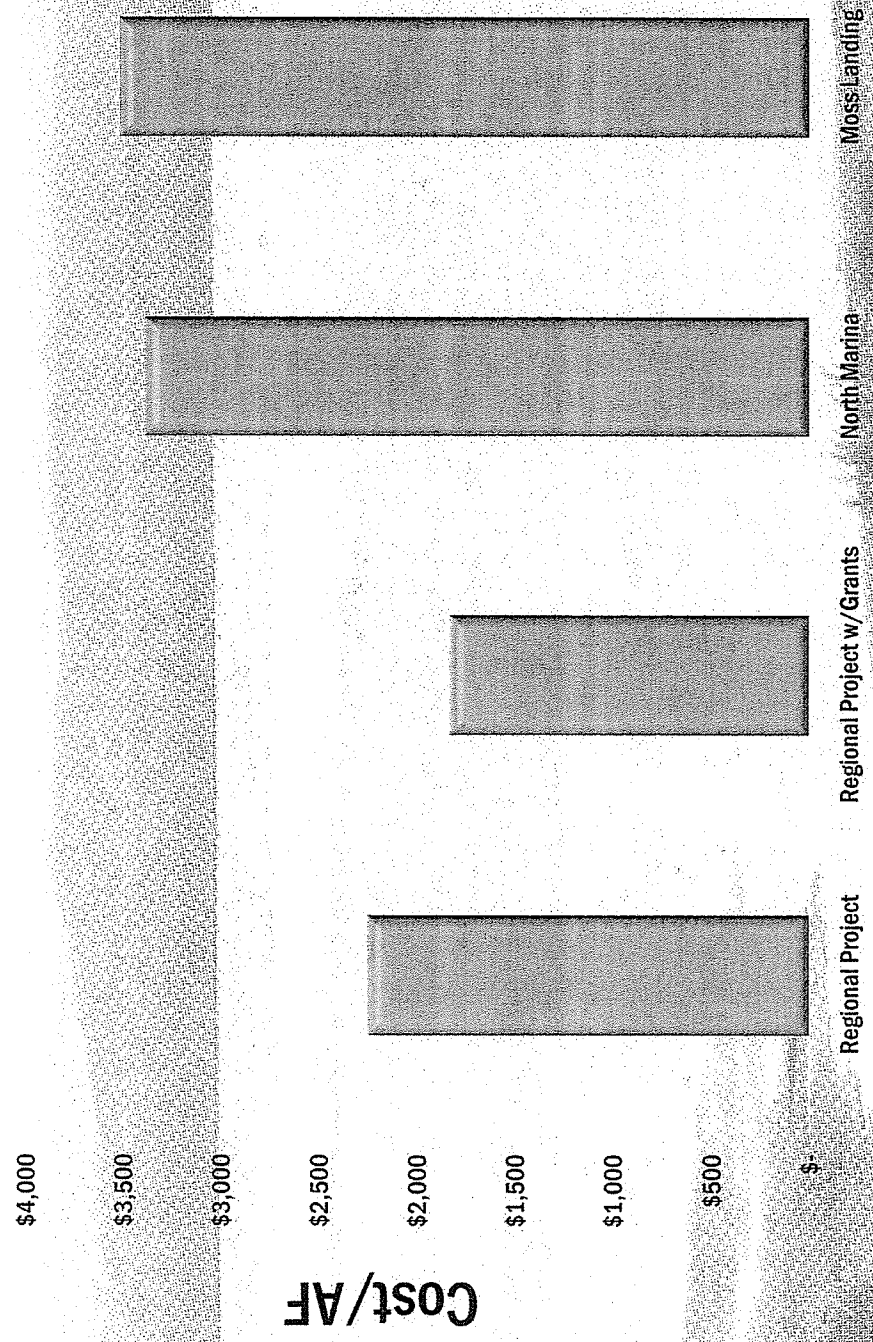

Alternative